


[See SRL report C/21600/R03 for full details](#)

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

Client: Rockfon
Test Date: 12/10/2011
Empty Room: Temperature: 17.5 °C Humidity: 75 %RH Pressure: 1015 mbar
Room with Sample: Temperature: 17.8 °C Humidity: 73 %RH Pressure: 1015 mbar
Sample Description: Rockfon Color-all 1200x600x40mm
Mounting Method: E-225
Sample Area: 12.74 m²
Chamber Volume: 300 m³

Test 11				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	5.99	4.09	0.30	
63*	5.01	3.38	0.37	n/a
80*	6.11	3.62	0.43	
100	8.36	4.19	0.45	
125	8.72	3.64	0.61	0.60
160	7.99	3.06	0.77	
200	8.24	2.79	0.90	
250	7.78	2.60	0.98	0.95
315	7.47	2.61	0.95	
400	6.91	2.50	0.97	
500	5.64	2.20	1.06	1.00
630	5.27	2.20	1.01	
800	5.69	2.37	0.94	
1000	6.36	2.31	1.05	1.00
1250	6.39	2.21	1.13	
1600	5.68	2.14	1.11	
2000	5.24	2.07	1.11	1.00
2500	4.75	1.98	1.12	
3150	4.09	1.84	1.14	
4000	3.43	1.67	1.16	1.00
5000	2.75	1.53	1.10	
6300*	2.09	1.29	1.12	
8000*	1.66	1.08	1.21	n/a
10000*	1.21	0.88	1.15	
<i>a_w</i> 1.00			Class A	
Calculated to EN ISO 11654:1997				
NRC 1.05				
Calculated to ASTM C 423-01				
* Denotes frequencies outside the range covered by BS EN ISO 354:2003				
T1, empty room reverberation time T2, room reverberation time with sample				

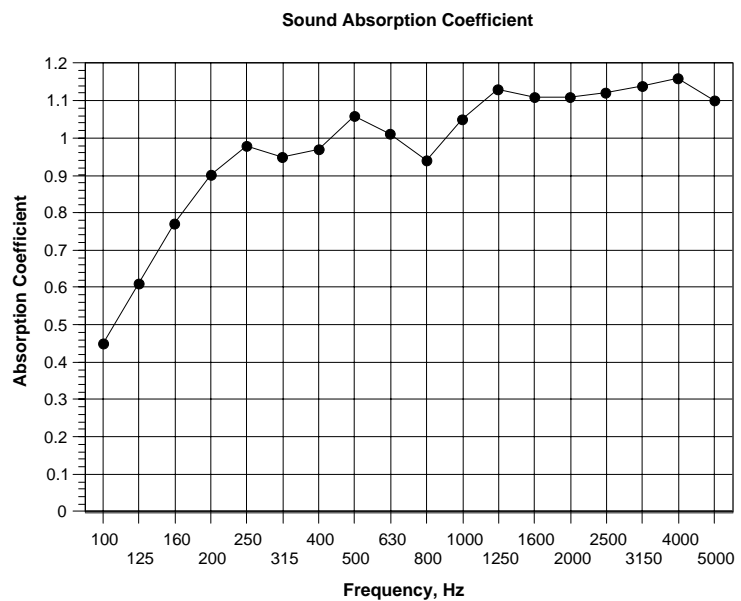

Practical absorption coefficient, BS EN ISO 11654:1997

v4.0

Quality Manager

Deputy Technical Manager