



Holbrook House, Little Waldingfield,  
Sudbury, Suffolk CO10 0TF  
Tel: +44 (0) 1787 247595  
e-mail: srl@srltstl.com

0444

Page: 1 of 1

Confidential


Date: 26 April 2021

See SRL Report 24507-25-SRL-RP-XT-001-PI for full details

Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

<b>Test Number:</b>	Test 2	<b>Test Room:</b>	Empty	<b>With Sample</b>
<b>Client:</b>	Rockfon	<b>Air Temperature:</b>	16 °C	15.9 °C
<b>Test Date:</b>	30/03/2021	<b>Air Humidity:</b>	58 % RH	55 % RH
<b>Chamber Volume:</b>	300.1 m <sup>3</sup>	<b>Air Pressure:</b>	1021 mbar	1020 mbar
<b>Mounting Method:</b>	E-200	<b>Sample Area:</b>	10.62 m <sup>2</sup>	
<b>Sample Description:</b>	Rockfon Color-All Special A15/24 600x600x20mm (T ceiling tiles)			

Frequency Hz	T1, empty room reverberation time sec	T2, room reverberation time with sample sec	Sound Absorption Coefficient $\alpha_s$	Practical Sound Absorption Coefficient $\alpha_p$
50*	4.87	4.35	0.11	n/a
63*	5.58	4.22	0.27	
80*	7.46	4.89	0.32	
100	7.19	4.49	0.38	0.60
125	7.09	3.74	0.58	
160	6.27	3.03	0.78	
200	6.32	2.95	0.83	0.85
250	6.55	2.90	0.88	
315	6.47	2.92	0.86	
400	6.17	2.66	0.98	1.00
500	5.38	2.52	0.97	
630	4.94	2.38	1.00	
800	5.01	2.56	0.88	0.90
1000	5.46	2.66	0.89	
1250	5.47	2.50	1.00	
1600	5.17	2.41	1.01	1.00
2000	4.80	2.35	0.99	
2500	4.29	2.17	1.03	
3150	3.53	1.87	1.13	1.00
4000	2.83	1.65	1.12	
5000	2.24	1.41	1.15	
6300*	1.57	1.08	1.23	n/a
8000*	1.32	0.95	1.22	
10000*	0.93	0.71	1.29	

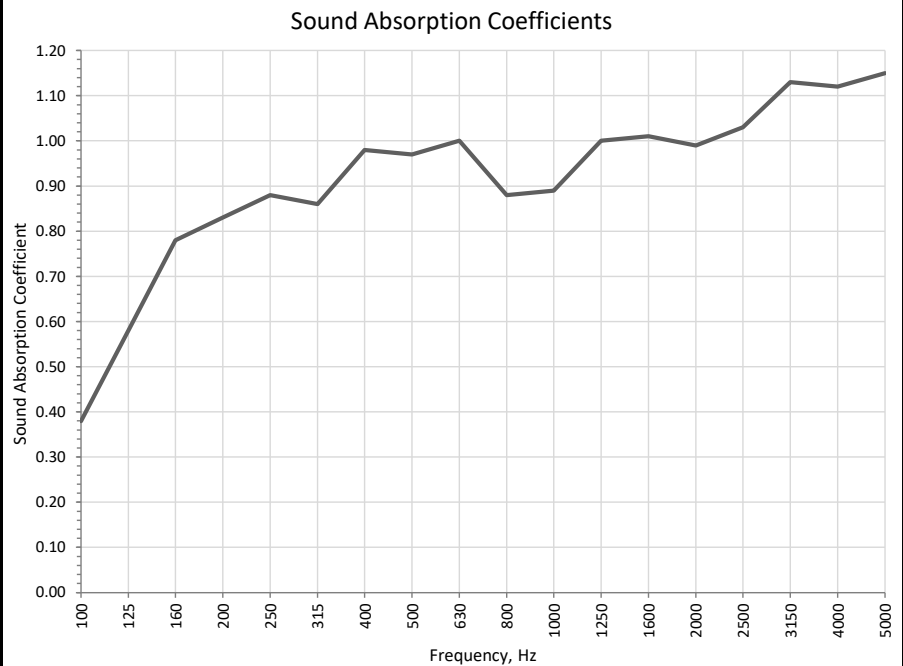

$\alpha_w$	1.00
<b>Class A</b>	
Calculated to BS EN ISO 11654:1997	
<b>NRC</b>	0.95
Calculated to ASTM C 423-01	
* Denotes frequencies outside the range covered by BS EN ISO 354:2003 and not UKAS accredited	
v1	

*Kieron Farrow*

**Kieron Farrow**  
Tester

**Allen Smalls**  
Quality Manager