



INVESTOR IN PEOPLE

Holbrook House, Little Waldingfield,
Sudbury, Suffolk CO10 0TH
Tel: (01787) 247595 Fax: 01787 248420
e-mail: srl@soundresearch.co.uk


See SRL report C/08/5L/20506/R03 for full details

The Laboratory Measurement of Random Incidence Sound Absorption to BS EN ISO 354:2003

Client: Rockfon
Test Date: 01/12/2008
Empty Room: Temperature: 17.7 °C Humidity: 36 %RH Pressure: 996 mbar
Room with Sample: Temperature: 17.1 °C Humidity: 37 %RH Pressure: 996 mbar
Sample: Rockshed Blanc - 1500x1000x75mm - A edge
Description:
Mounting Method: E- 255
Sample Area: 10.8 m2
Chamber Volume: 300 m3

Sound Absorption Coefficient

Test 8				
Freq Hz	T1 sec	T2 sec	Absorp Coeff	Practical Absorp Coeff #
50*	4.07	3.71	0.11	
63*	4.20	2.57	0.68	n/a
80*	5.02	2.98	0.61	
100	7.17	3.77	0.57	
125	7.70	3.40	0.74	0.70
160	6.92	2.99	0.86	
200	6.90	3.18	0.76	
250	6.92	2.98	0.86	0.85
315	6.64	2.69	1.00	
400	5.88	2.53	1.02	
500	4.99	2.28	1.07	1.00
630	4.95	2.17	1.17	
800	5.22	2.20	1.19	
1000	5.54	2.28	1.16	1.00
1250	5.33	2.24	1.17	
1600	4.79	2.12	1.19	
2000	4.19	2.02	1.16	1.00
2500	3.52	1.85	1.16	
3150	2.83	1.64	1.16	
4000	2.21	1.39	1.20	1.00
5000	1.61	1.14	1.16	
6300*	1.18	0.91	1.14	
8000*	0.90	0.76	0.93	n/a
10000*	0.64	0.57	0.89	

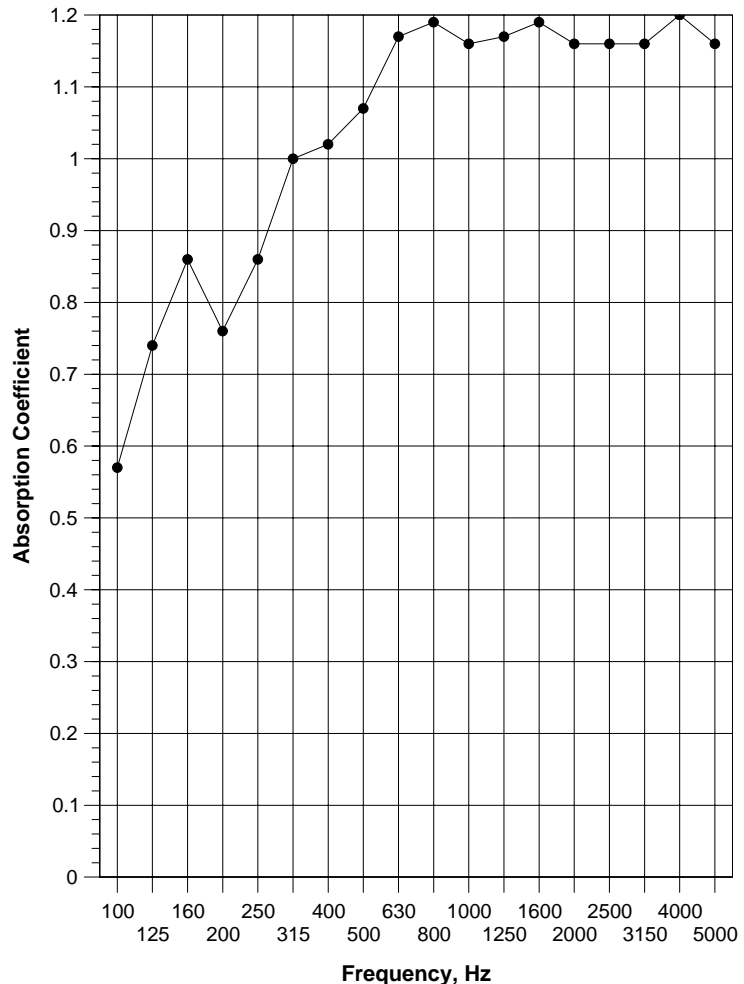

a_w 1.00
Class A
 Calculated to EN ISO 11654:1997
NRC 1.05
 Calculated to ASTM C 423-01
 * Denotes frequencies outside the range covered by BS EN ISO 354:2003
 T1, empty room reverberation time
 T2, room reverberation time with sample

Practical absorption coefficient, BS EN ISO 11654:1997

v3